




## Greys Fire Station Case Study

**Details:** Installation of two standard free standing mobile drying systems within the existing Drying Room as part of a heating and hot water upgrade.


**Comments:** "The heating system use to run 365 days a year/ 24 hours a day even throughout the summer just to heat the drying room. Heating bills have been reduced and the station is now a lot cooler in the summer especially in the dormitory next to the drying room".



Greys Fire Station

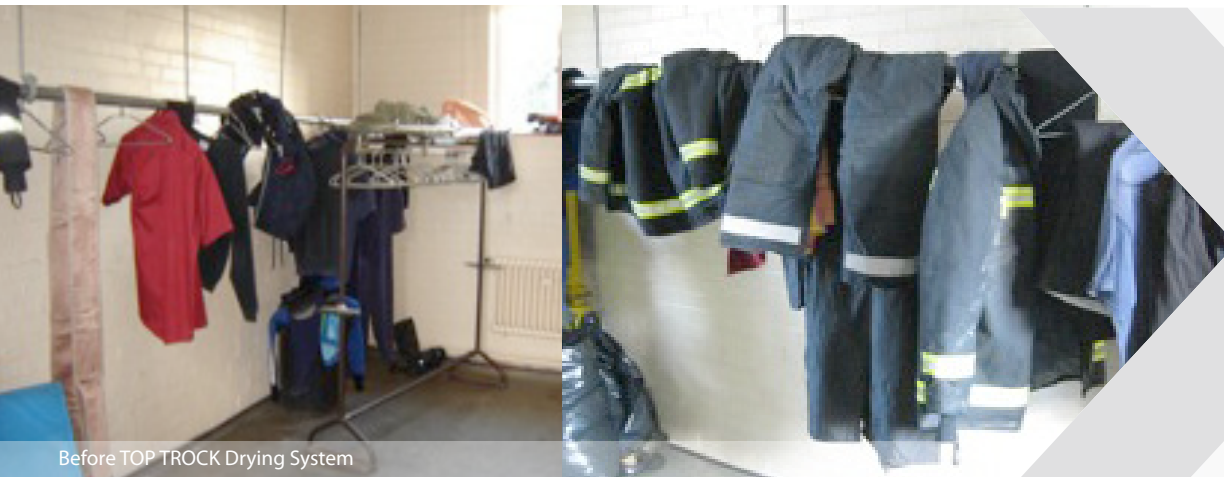

Before TOP TROCK Drying System

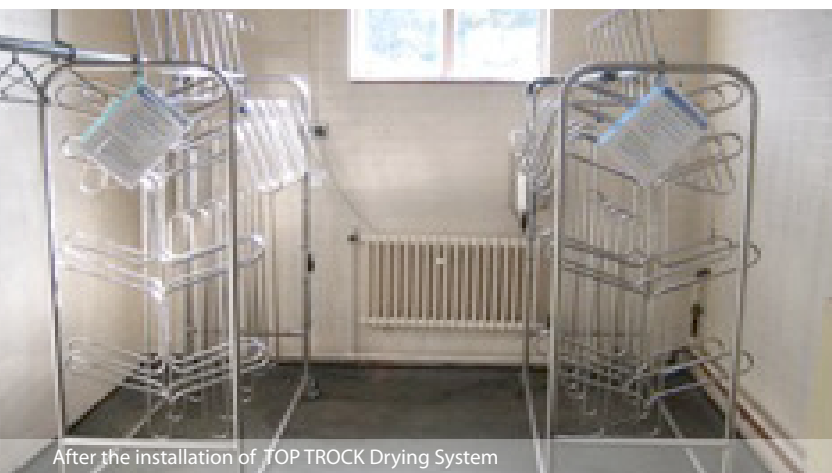

After the installation of TOP TROCK Drying System

